# SUBMITTAL AM053TXMDCH/AA

Samsung DVM S Eco Series, Heat Pump Condensing Unit

Job Name	Location _			
Purchaser	Engineer			
Submitted to	Reference	Approval	Construction	
Unit Designation	Schedule #			

Unit Design	ation		S	
		System Specifications		
	US Ton (nominal) 4.42			
Performance	Capacity (Btu/h)	Nominal Cooling <sup>1</sup>	53,000	
		Nominal Heating <sup>1</sup>	61,000	
	System Modulation down to (Btu/h)		7,500	
	SEER	Ducted / Non-Ducted	17.5 / 20.0	
	EER	Ducted / Non-Ducted	9.45 / 11.5	
	HSPF	Ducted / Non-Ducted	10.0 / 11.0	
Power	Voltage	(ø/V/Hz)	1 / 208-230 / 60	
	Maximum Circuit Breaker (MCCB/ELB/ELCB)		50	
	Minimum Circuit Ampacity (MCA)		34	
Indoor Units	Total Capacity (%)		50 - 130% Of Outdoor Capacity	
	Maximum Indoor Unit Quantity		10	
	Туре		Twin BLDC Rotary X1	
Compressor	RLA	A	26.0	
	Туре		R410A	
Refrigerant	Factory Charge lbs.		7.3	
Pipe Connections	Liquid X Suction		3/8 X 3/4	
Commodulo	Max. Distance - ODU to IDU (feet)		492 (574 equivalent)	
Installation	Vertical Separation ODU to IDU <sup>3</sup>		164 / 131	
Limitation <sup>2</sup>	(feet)	Highest/Lowest IDU	49	
	Total Refrigerant Pipe (feet)		984	
	Fan	Туре	Propeller X 2	
		Output (CFM)	3,885	
Condenser Fan	Motor	Туре	BLDC	
		Output (W) / FLA (A)	125 X 2 / 0.6	
Dimensions	WXHXD	Inches	37 X 47 5/8 X 13	
Dimensions	Weight	lbs.	227	
Sound Level	Max. dB (A)	Cooling / Heating	53 / 55	
Operating Temperature Range	Cooling <sup>3</sup>	°F	0°F ~ 118°F (-18°C ~ 48°C)	
	Heating	°F	-13°F ~ 75°F (-25°C ~ 24°C)	
Accessories		Front	WBF-1M2	
	Wind Baffles	Back	WBB-2M	
	Wi-Fi Adapter		MIM-H04UN	
	Mode Selector Switch For HP Systems		MCM-C200U	
	Base Pan Heater Kit		MHC-015EE	
	External contact control interface module (operation and error output, night silent mode manual activation)		MIM-B14	
Safety Certificati	ons		ETL (UL 1995)	
Protection	Intelligent logic to ensure proper operation within unit design limitations and operational parameters			
i iotection				

	protection, fan motor thermal protection, high voltage fuses			
<sup>1</sup> Certified in accordance with the AHRI Unitary Small Air-Source Heat Pumps (USHP) Certification Program				
which is based on th	e latest edition of AHRI Standard 210/240.			

High pressure sensor, low pressure sensor, over-voltage protection,

compressor over-current protection, current transformer, fan motor voltage



Page 1 of 2

# Compatibility

Only compatible with Samsung DVM S indoor units (AM\*\*\*\*N\*\*\*H\*\*\*) and MCM-D211UN Universal Communication Kit.

## Construction

The unit shall be galvanized steel with a baked on powder coated finish

Refrigerant pipe connections inside unit chassis with penetrations available on front, back, right, and bottom sides for versatile installation

#### **Heat Exchanger**

The heat exchanger shall be mechanically bonded fin to copper tube.

Salt spray test method: ASTM-B117-18 - the heat exchanger showed no unusual rust or corrosion development to 2,280 hours.

## Controls

The unit shall be operated via NASA Protocol with controls provided by Samsung

Control wiring shall be 16 AWG X 2 shielded wire.

## Refrigerant System

The compressors shall be Samsung hermetically sealed, inverter driven, twin BLDC Rotary type.

Refrigerant flow shall be controlled by EEV (electronic expansion valve) throughout the system.

A flat plate subcooler device will improve capacity at extreme system refrigerant pipe lengths and reduce refrigerant noise.

## Other Features

Optional night quiet modes to reduce outdoor unit sound

Optional snow blowing logic to prevent snow drifting on idle outdoor units






Devices

<sup>&</sup>lt;sup>2</sup> Other pipe restrictions and requirements exist. Please consult installation manuals or technical data book for full details.

<sup>&</sup>lt;sup>3</sup> Vertical separation: 131' when outdoor unit is lower than the indoor units, 164' when the outdoor unit is higher than the indoor units.

 $<sup>^4</sup>$  When cooling in outside temperatures between 0°F  $\sim 23^\circ F$ , wind baffles are required. When outside temperature is between 0°F  $\sim 23^\circ F$ , 50% operating capacity should be maintained to ensure reliability while in cooling mode.

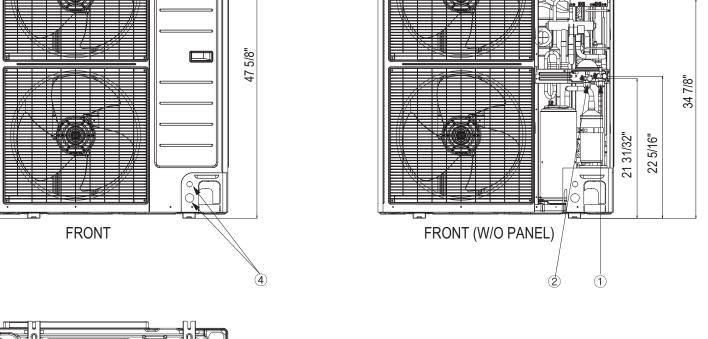

- BOTTOM
  - (1) Gas refrigerant pipe opening
  - 2 Liquid refrigerant pipe opening
- (3) Condensate drain holes
- 4 Communication conduit opening (2 X Ø1 3/8")

888-699-6067 www.SamsungHVAC.com