

## Samsung DVM S Eco Series, Heat Pump Condensing Unit

Job Name \_\_\_\_\_  
 Purchaser \_\_\_\_\_  
 Submitted to \_\_\_\_\_  
 Unit Designation \_\_\_\_\_

Location \_\_\_\_\_  
 Engineer \_\_\_\_\_  
 Reference \_\_\_\_\_ Approval \_\_\_\_\_ Construction \_\_\_\_\_  
 Schedule # \_\_\_\_\_

## System Specifications

|                                      |   |                              |                               |
|--------------------------------------|---|------------------------------|-------------------------------|
| Performance                          | US Ton (nominal)  |                              | 4.0                           |
|                                      | Capacity (Btu/h)  | Nominal Cooling <sup>1</sup> | 48,000                        |
|                                      |   | Nominal Heating <sup>1</sup> | 54,000                        |
|                                      | System Modulation down to (Btu/h)   |                              | 7,500                         |
|                                      | SEER  | Ducted / Non-Ducted          | 17.2 / 21.0                   |
|                                      | EER   | Ducted / Non-Ducted          | 10.2 / 11.5                   |
|                                      | HSPF  | Ducted / Non-Ducted          | 10.4 / 10.7                   |
| Power                                | Voltage   | (øV/Hz)                      | 1 / 208-230 / 60              |
|                                      | Maximum Circuit Breaker (MCCB/ELB/ELCB)   |                              | 50                            |
|                                      | Minimum Circuit Ampacity (MCA)  |                              | 29                            |
| Indoor Units                         | Total Capacity (%)  |                              | 50 - 130% Of Outdoor Capacity |
|                                      | Maximum Indoor Unit Quantity  |                              | 9                             |
| Compressor                           | Type  |                              | Twin BLDC Rotary X1           |
|                                      | RLA   | A                            | 22.1                          |
| Refrigerant                          | Type  |                              | R410A                         |
|                                      | Factory Charge  | lbs.                         | 7.1                           |
| Pipe Connections                     | Liquid X Suction  |                              | 3/8 X 5/8                     |
| Installation Limitation <sup>2</sup> | Max. Distance - ODU to IDU (feet)   |                              | 492 (574 equivalent)          |
|                                      | Vertical Separation (feet)  | ODU to IDU <sup>3</sup>      | 164 / 131                     |
|                                      |   | Highest/Lowest IDU           | 49                            |
|                                      | Total Refrigerant Pipe (feet)   |                              | 984                           |
| Condenser Fan                        | Fan   | Type                         | Propeller X 2                 |
|                                      |   | Output (CFM)                 | 3,885                         |
|                                      | Motor   | Type                         | BLDC                          |
|                                      |   | Output (W) / FLA (A)         | 125 X 2 / 0.6                 |
| Dimensions                           | W X H X D   | Inches                       | 37 X 47 5/8 X 13              |
|                                      | Weight  | lbs.                         | 216.1                         |
| Sound Level                          | Max. dB (A)   | Cooling / Heating            | 51 / 53                       |
| Operating Temperature Range          | Cooling <sup>4</sup>  | °F                           | 0°F ~ 118°F (-18°C ~ 48°C)    |
|                                      | Heating   | °F                           | -13°F ~ 75°F (-25°C ~ 24°C)   |
| Accessories                          | Wind Baffles  | Front                        | WBF-1M2                       |
|                                      |   | Back                         | WBB-2M                        |
|                                      | Wi-Fi Adapter   |                              | MIM-H04UN                     |
|                                      | Mode Selector Switch For HP Systems   |                              | MCM-C200U                     |
|                                      | Base Pan Heater Kit   |                              | MHC-015EE                     |
|                                      | External contact control interface module (operation and error output, night silent mode manual activation)   |                              | MIM-B14                       |
| Safety Certifications                |   |                              | ETL (UL 1995)                 |
| Protection Devices                   | Intelligent logic to ensure proper operation within unit design limitations and operational parameters  |                              |                               |
|                                      | High pressure sensor, low pressure sensor, over-voltage protection, compressor over-current protection, current transformer, fan motor voltage protection, fan motor thermal protection, high voltage fuses |                              |                               |



## Compatibility

Only compatible with Samsung DVM S indoor units (AM\*\*\*\*N\*\*\*H\*\*\*) and MCM-D211UN Universal Communication Kit.

## Construction

The unit shall be galvanized steel with a baked on powder coated finish

Refrigerant pipe connections inside unit chassis with penetrations available on front, back, right, and bottom sides for versatile installation

## Heat Exchanger

The heat exchanger shall be mechanically bonded fin to copper tube.

Salt spray test method: ASTM-B117-18 - the heat exchanger showed no unusual rust or corrosion development to 2,280 hours.

## Controls

The unit shall be operated via NASA Protocol with controls provided by Samsung

Control wiring shall be 16 AWG X 2 shielded wire.

## Refrigerant System

The compressors shall be Samsung hermetically sealed, inverter driven, twin BLDC Rotary type.

Refrigerant flow shall be controlled by EEV (electronic expansion valve) throughout the system.

A flat plate subcooler device will improve capacity at extreme system refrigerant pipe lengths and reduce refrigerant noise.

## Other Features

Optional night quiet modes to reduce outdoor unit sound





Optional snow blowing logic to prevent snow drifting on idle outdoor units

<sup>1</sup> Certified in accordance with the AHRI Unitary Small Air-Source Heat Pumps (USHP) Certification Program which is based on the latest edition of AHRI Standard 210/240.

<sup>2</sup> Other pipe restrictions and requirements exist. Please consult installation manuals or technical data book for full details.

<sup>3</sup> Vertical separation: 131' when outdoor unit is lower than the indoor units, 164' when the outdoor unit is higher than the indoor units.

<sup>4</sup> When cooling in outside temperatures between 0°F ~ 23°F, wind baffles are required. When outside temperature is between 0°F ~ 23°F, 50% operating capacity should be maintained to ensure reliability while in cooling mode.

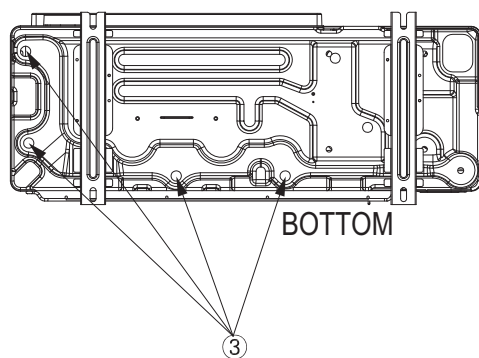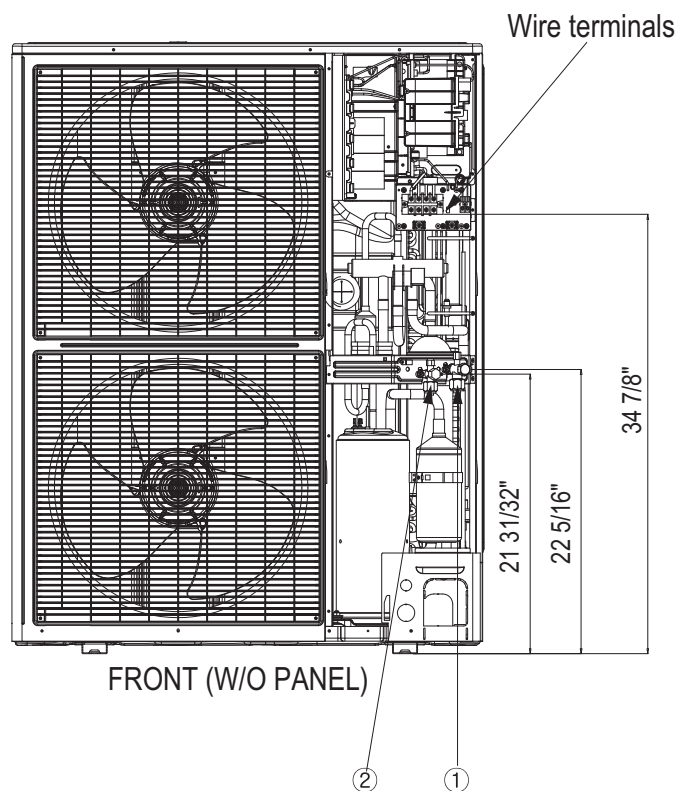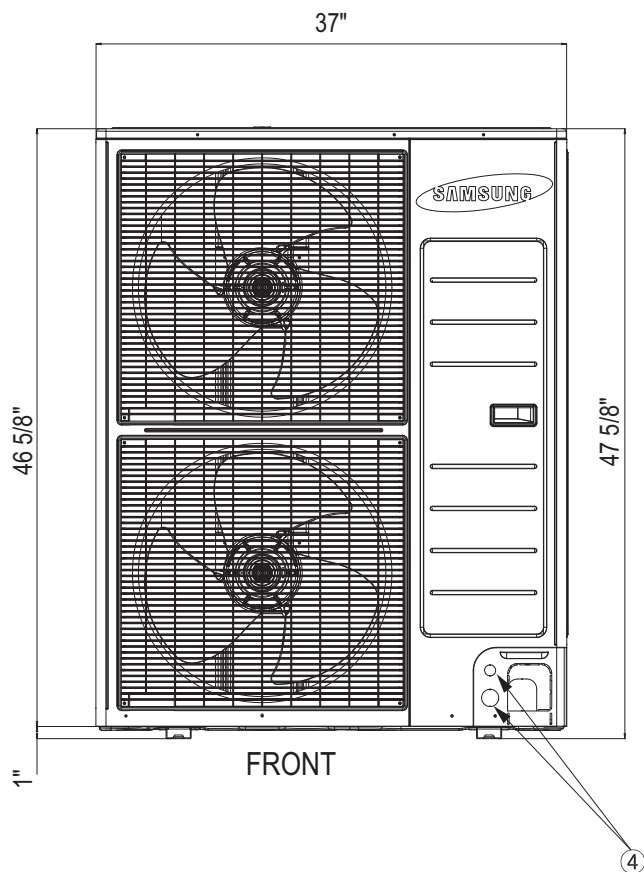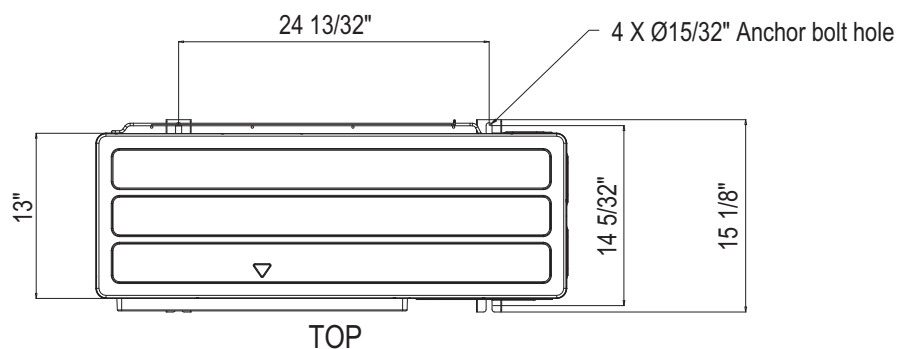

- ① Gas refrigerant pipe opening
- ② Liquid refrigerant pipe opening

- ③ Condensate drain holes
- ④ Communication conduit opening (2 X Ø1 3/8")